


Javo Plus

Version 1.0
11-03-2011

			Datum		JAVO Plus		Voorblad Title sheet	Plus13C	=	2
			Eng.	Wout Louter						
			Gez.	30. Mei. 2011						
Wijziging	Datum	Naam	Norm							


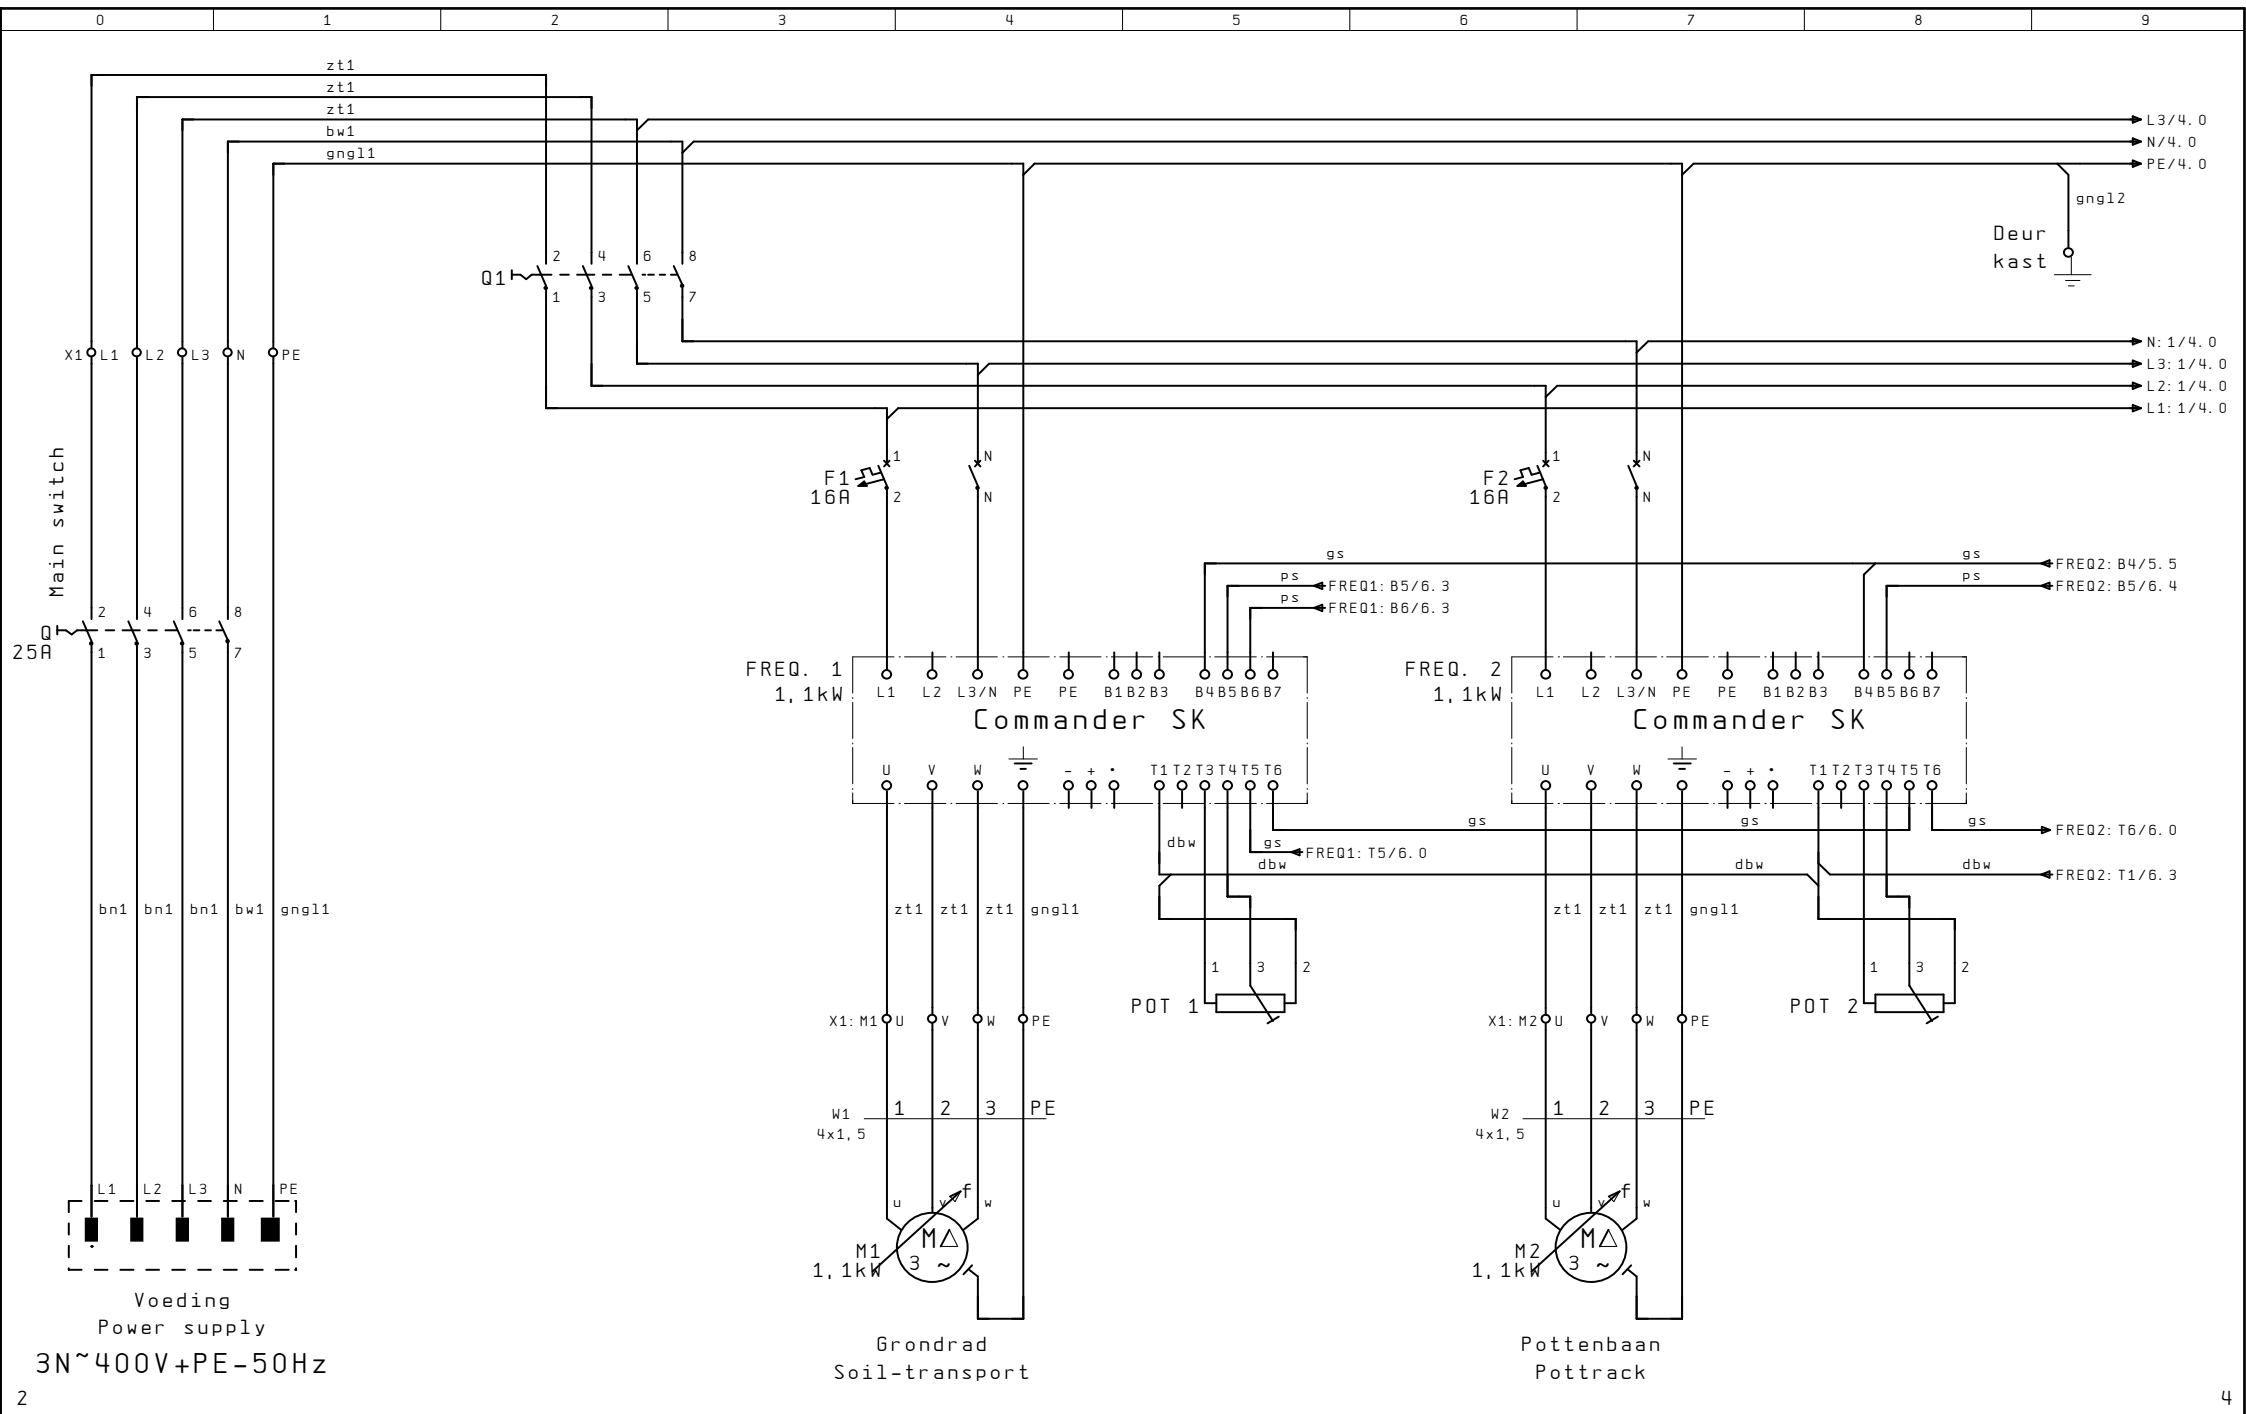


Voeding
Power supply
3N~400V+PE-50Hz

Grondrad
Soil-transport

Pottenbaan
Pottrack

				Datum							
				Eng.	Wout Louter	JAVO Plus		TAVO		Hoofdstroom	
				Gez.	30. Mei. 2011			HOLLAND		Plus13C	
										=	
										+	
										B1. 3	
										8 B1	

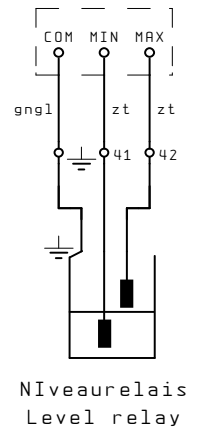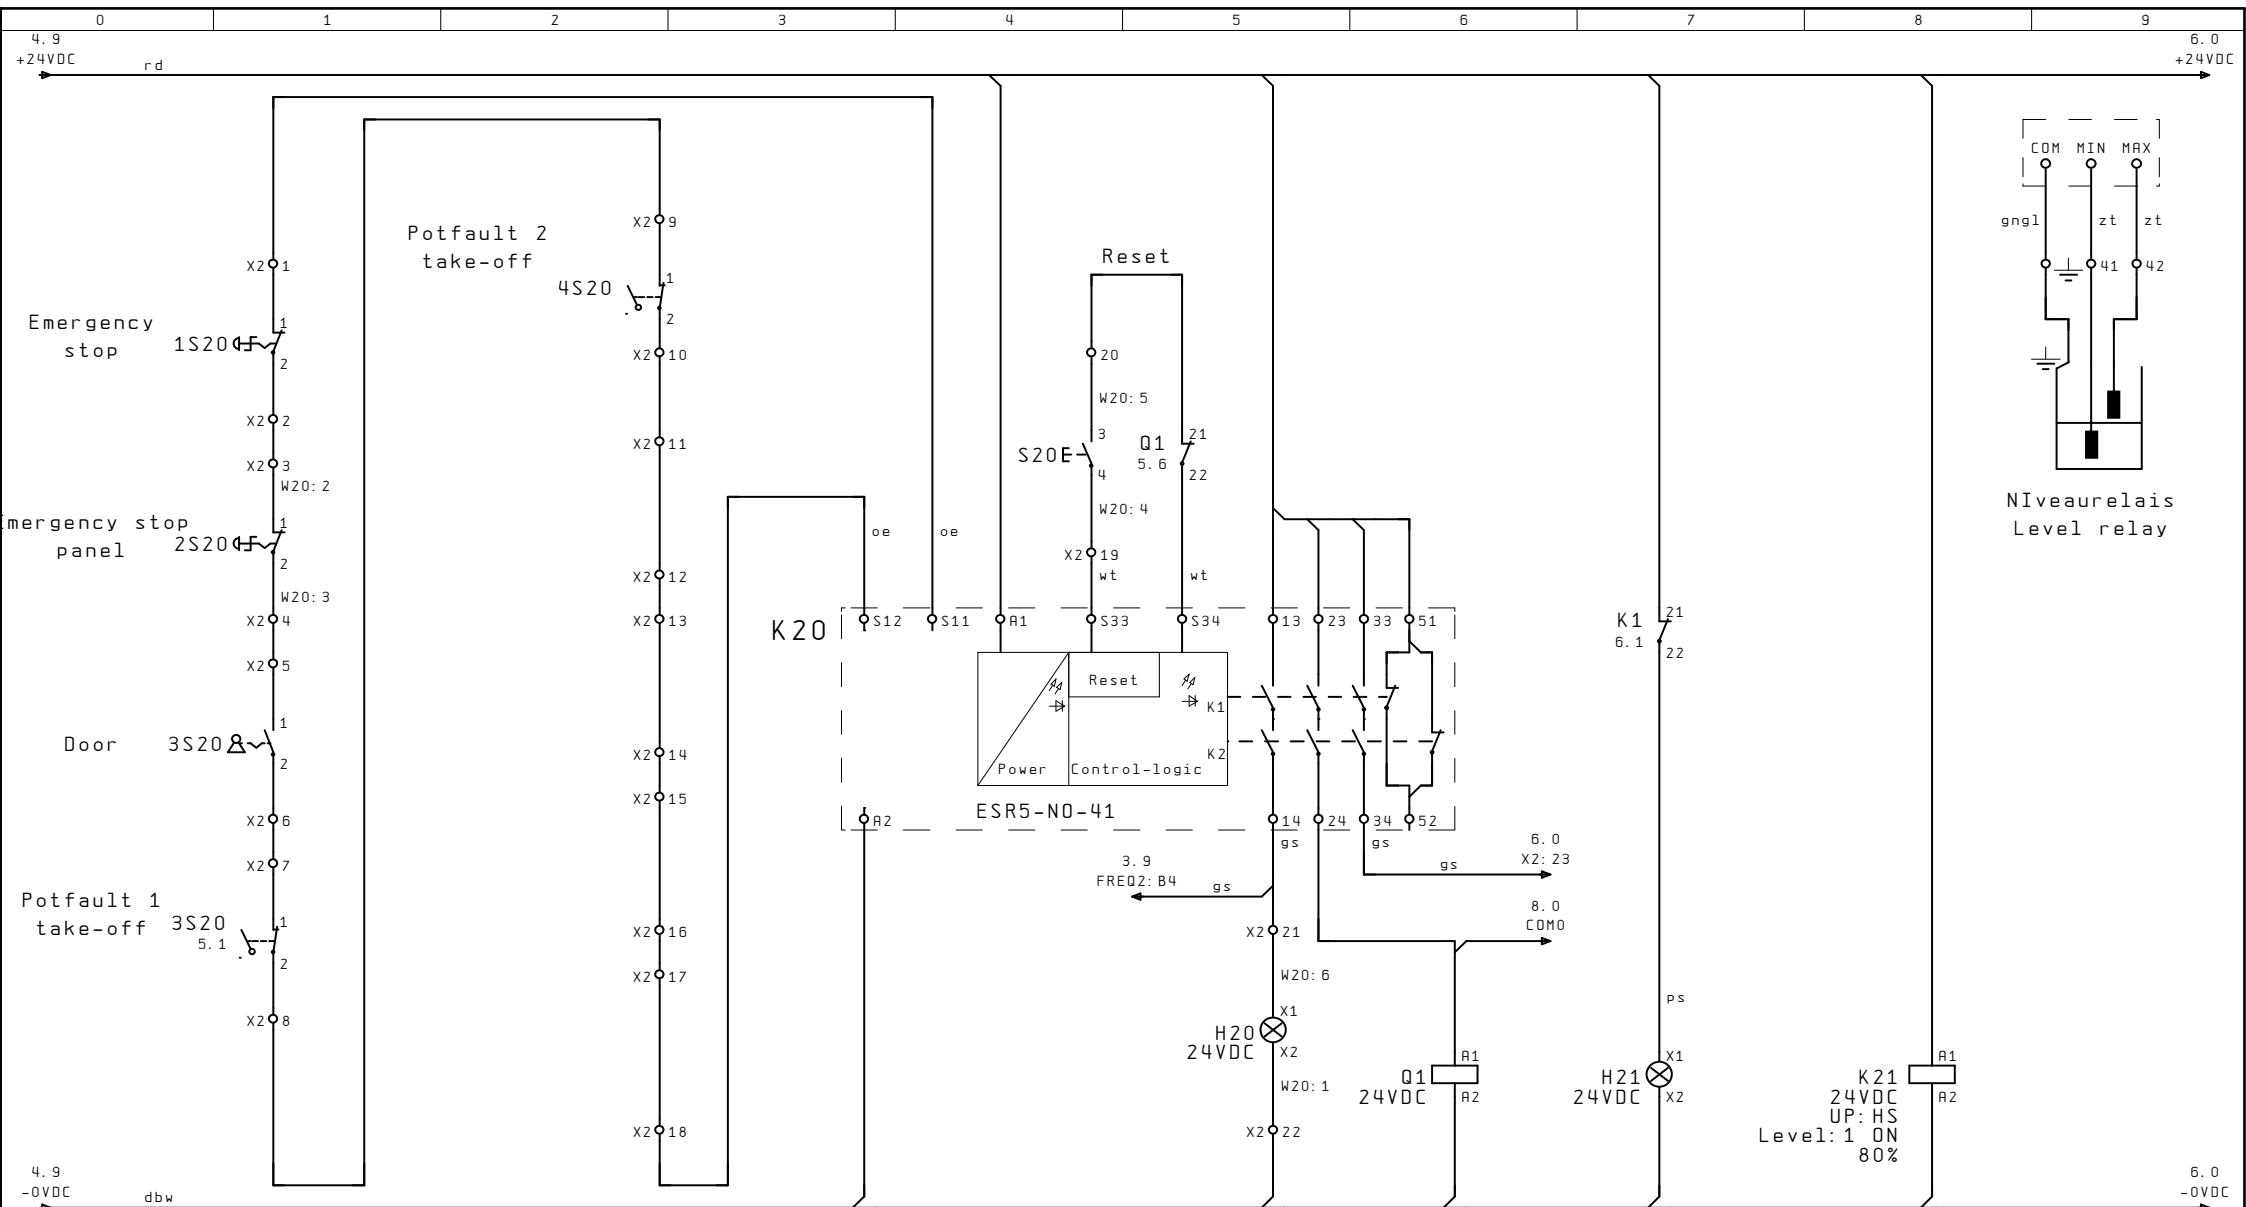


Noodstopcircuit
Emergency stop circuit


Noodstoprelais
Emergency stop relay

Machine paraat
Machine stand-by


Machine gestopt
Machine gestopt



				Datum					
				Eng.	Wout Louter				
				Gez.	30. Mei. 2011				
Wijziging	Datum	Naam	Norm	JAVO Plus				Stuurstroom Control voltage	
				TAVO HOLLAND				Plus13C	
								=	
								+	
								B1. 5	
								8 B1	

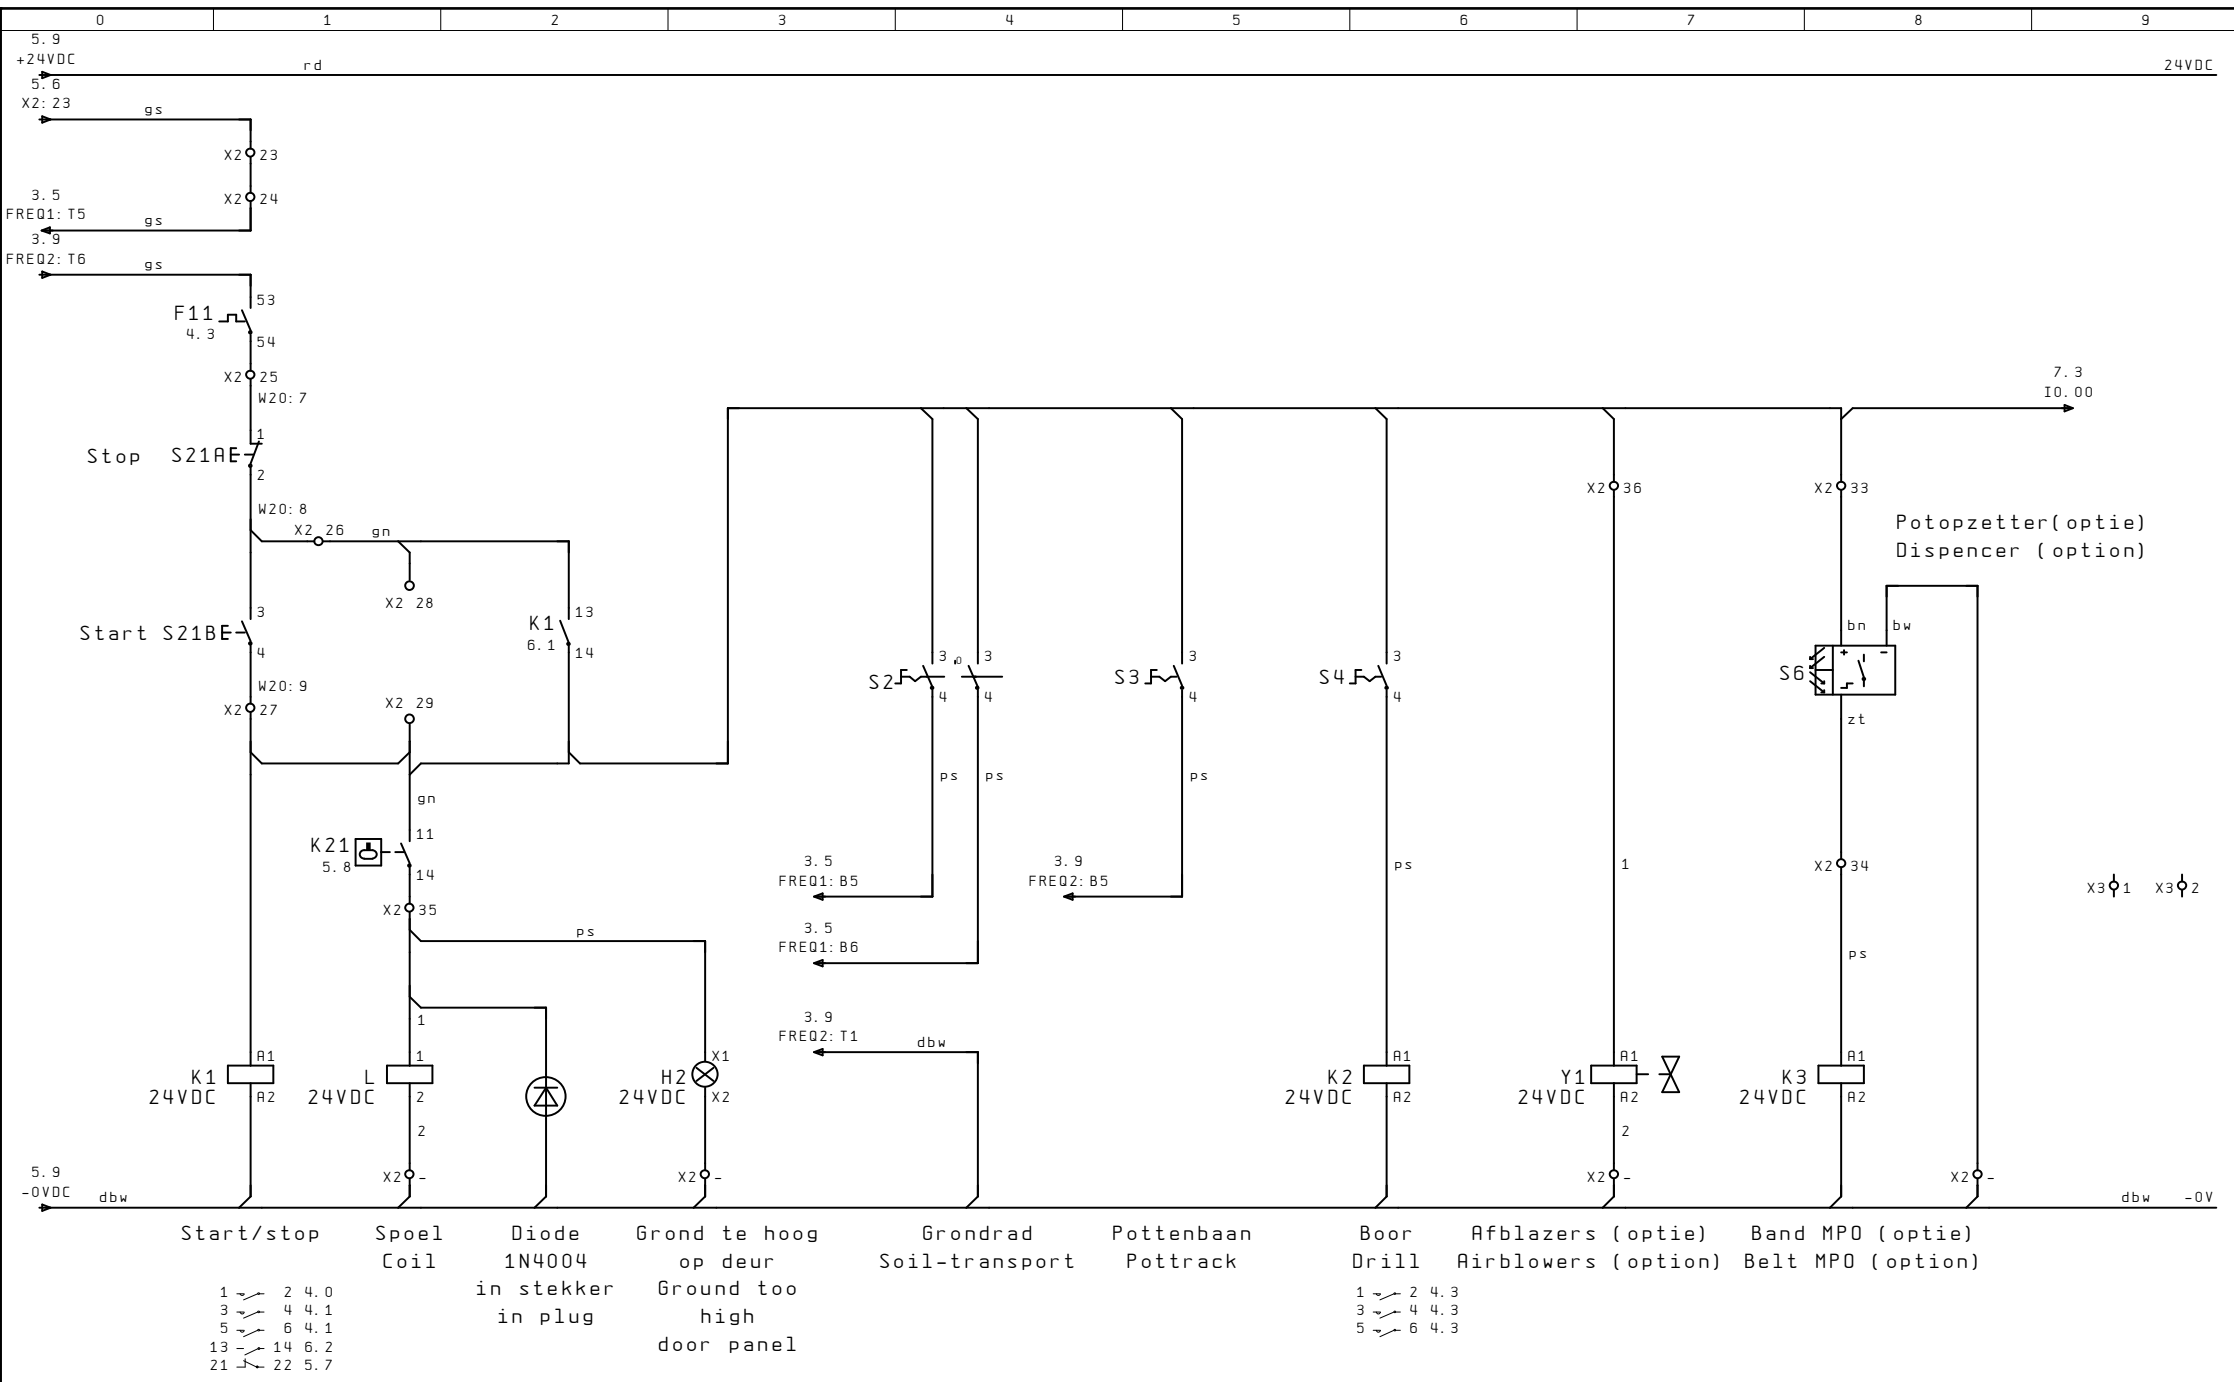

				Datum				
				Eng.	Wout Louter			
				Gez.	30. Mei. 2011			
				JAVO Plus				
				Stuurstroom Control voltage				
				Plus13C				
				=				
				+				
				B1.	6			
					8 B1.			
Wijziging				Datum	Naam			
				Norm				

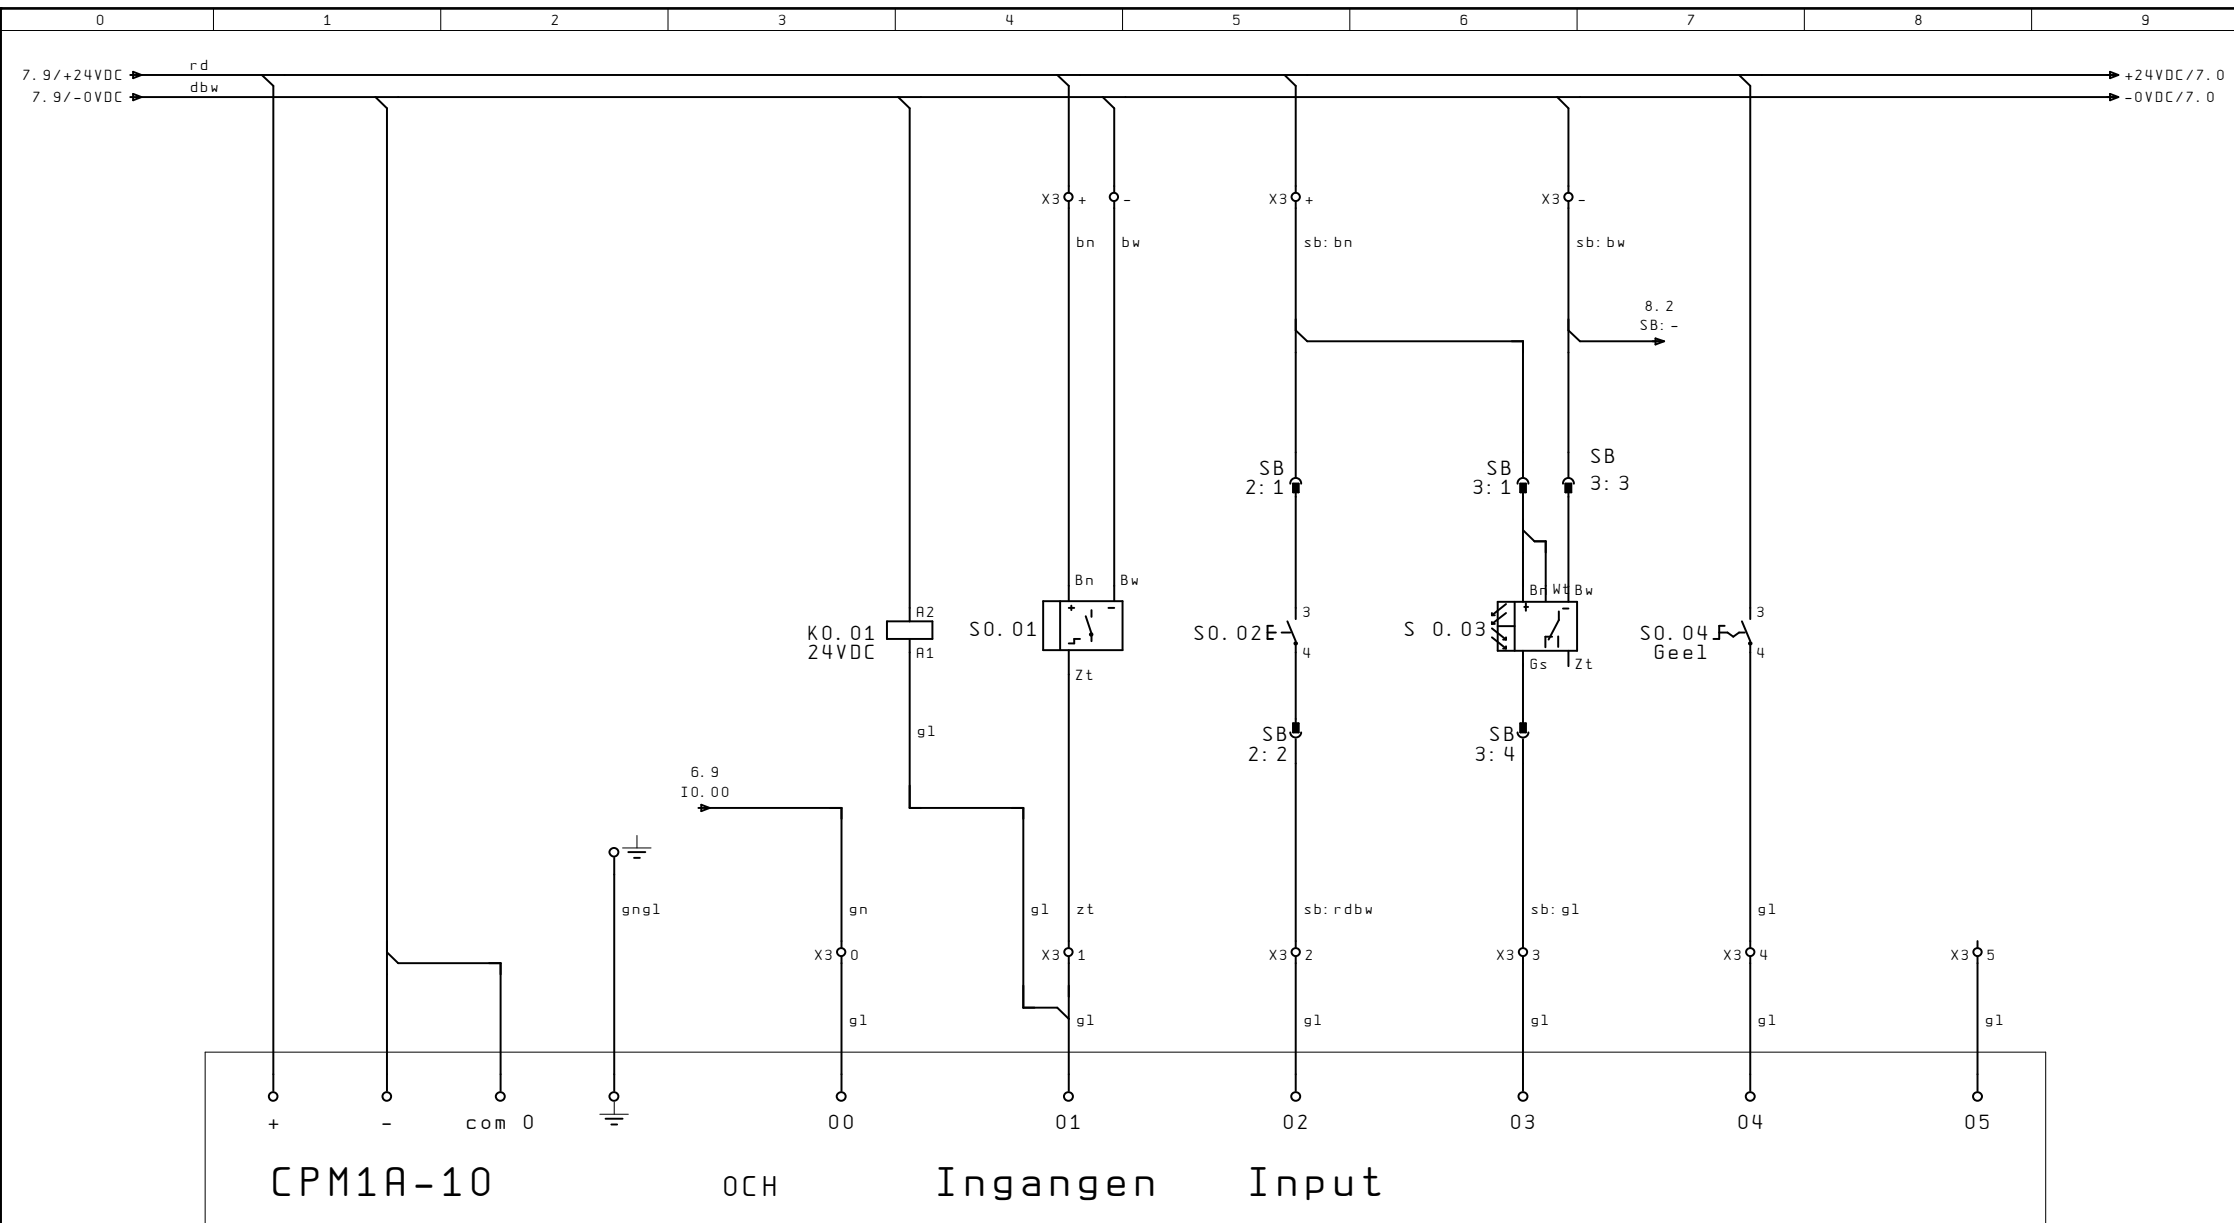

CPM1A-10

0CH

Ingangen

Input

Machine in bedrijf Puls start LPO
 Machine runs Pulse dispenser

Testknop potrijhouders
 Testbutton potrowholders

Potten aanwezig
 Pots present

Continu
 Continuous

LPO / Dispenser

	Datum	
	Eng.	Wout Louter
	Gez.	30. Mei. 2011
Wijziging	Datum	Naam

JAVO Plus



PLC ingangen 0CH00-05
 PLC inputs 0CH00-05

Plus13C

=	
+	
	B1. 7
	8 B1

Trädgårdsteknik AB
Helsingborgsvägen Varalöv
262 96 ÄNGELHOLM
Tel: 0431-22290
Fax: 0431-22270
Mail: info@[tradgardsteknik.se](mailto:info@tradgardsteknik.se)
Webb: www.tradgardsteknik.se